

KASSETSART UNIVERSITY

DEPARTMENT OF CIVIL ENGINEERING, GEOTECHNICAL ENGINEERING LABORATORY
CONSOLIDATION TEST (ASTM D-2435)

PROJECT ร.พ.แห่งใหม่ กรมทหารเรือ
 TEST BY เฉลิมชัย

OWNER _____
DATE 12/9/1946

JOB NO. _____ 1
CHECK BY _____

PRESSURE INCREMENT


APPLIED PRESSURE	ksc.
------------------	------

TO ksc.

SCALE LOAD 1 Kg.

TO 2 Kg.

DATE	TIME	ELAPSED TIME	SQR. TIME	DIAL READING (mm.) 0.0001"
5-๙.๓.-47		0.25	0.50	340
		0.5	0.71	350
		1	1.00	363
		2	1.41	380
		4	2.00	405
	8.48	8	2.83	440
	8.56	16	4.00	485
	9.10	30	5.48	514
	9.40	60	7.75	578
	10.40	120	10.95	620
	11.40	180	13.42	639
	13.00	276	16.61	650
	17.10	522	22.85	683
	19.00	636	25.22	687

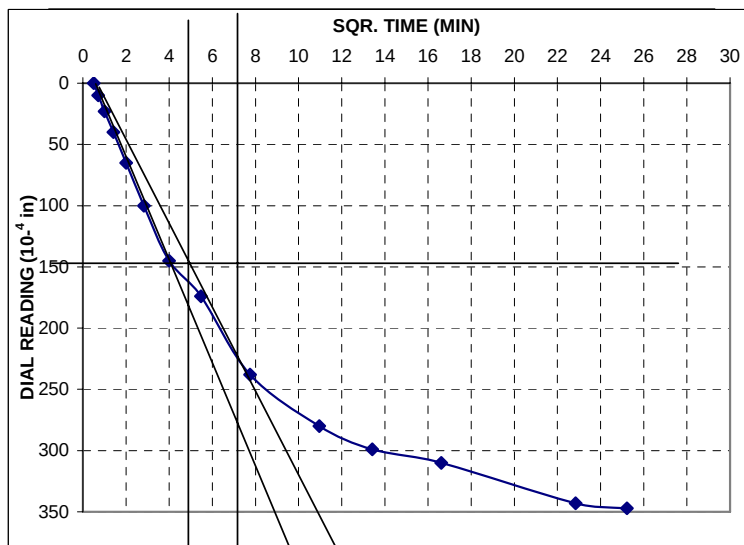

t ₉₀	65.00	min
-----------------	-------	-----

Approved by: _____
Dr. Suttisak Soralump

- Remarks: 1) Certification applies to test samples only.
2) Information under "For", "Project", are supplied by client. These are not certified.
3) This certificate is invalid without appropriate signature and seal.